

CERTIFICATE

of constancy of performance

1922 - CPR - 1156

In compliance with Regulation (EU) 305/2011 of the European Parliament and of the Council of 9 March 2011 (the Construction Products Regulation or CPR), this certificate applies to the construction product

Fire detection and fire alarm systems. Smoke detectors. Point detectors using scattered light, transmitted light or ionization. Optical Smoke Detectors.

Models: OD24 and OD24-5

(For list of controlled characteristics, see Annex I to 1922 - CPR - 1156 that is an inseparable part of this certificate)

produced by

EDS Elektronik Destek San. ve Tic. Ltd. Şti

Meclis Mah. Teraziler Cad. Hayran Sok. No:4 Postal Code : 34785

Sancaktepe/ İstanbul/ Türkiye

and produced in the manufacturing plant of

EDS Elektronik Destek San. ve Tic. Ltd. Şti

Meclis Mah. Teraziler Cad. Hayran Sok. No:4 Postal Code : 34785

Sancaktepe/ İstanbul/ Türkiye

This certificate attests that all provisions concerning the assessment and verification of constancy of performance described in Annex ZA of the standard

EN 54-7:2018

under system 1 for the performance set out in this certificate are applied and that the factory production control conducted by the manufacturer is assessed to ensure the constancy of performance of the construction product.

This certificate was first issued on 21.05.2019 and will remain valid until 21.05.2024 as long as neither the harmonised standard, the construction product, the AVCP methods nor the manufacturing conditions in the plant are modified significantly, unless suspended or withdrawn by the notified product certification body. The certificate is supported through annual surveillance audit and is reissued after each surveillance audit. The validity of the certificate may be confirmed in the CE register at the web address www.dedal-bg.net.



Manager:

Anna Vasileva



dipl. eng. Anna Vasileva

Issued:
Burgas, 27 September 2023

Ref. No. 04-00

ANNEX I TO CERTIFICATE OF CONSTANCY OF PERFORMANCE 1922-CPR-1156/ 27.09.2023, page 1/2

Optical Smoke Detector, model OD24

Performance list, acc. to EN 54-7:2018

Essential Characteristics	Performance	Clause
Operational reliability		
- Individual alarm indication	Pass	4.2.1
- Connection of ancillary devices	N/A	4.2.2
- Monitoring of detachable detectors	Pass	4.2.3
- Manufacturer's adjustments	Pass	4.2.4
- On site adjustment of response behaviour	N/A	4.2.5
- Protection against the ingress of foreign bodies	Pass	4.2.6
- Response to slowly developing fires	Pass	4.2.7
- Software controlled detector (when provided)	Pass	4.2.8
Nominal activation conditions / Sensitivity		
- Repeatability	Pass	4.3.1
- Directional dependence	Pass	4.3.2
- Reproducibility	Pass	4.3.3
Response delay (response time)		
- Air movement	Pass	4.4.1
- Dazzling	Pass	4.4.2
Tolerance to supply voltage		
- Variation in supply parameters	Pass	4.5
Performance parameters under fire conditions:		
- Fire sensitivity	Pass	4.6
Durability of Nominal activation condition/ Sensitivity		
Temperature resistance		
- Cold (operational)	Pass	4.7.1.1
- Dry heat (operational)	Pass	4.7.1.2
Humidity resistance		
- Damp heat, steady - state (operational)	Pass	4.7.2.1
- Damp heat, steady - state (endurance)	Pass	4.7.2.2
Corrosion resistance		
- Sulphur dioxide (SO ₂) corrosion (endurance)	Pass	4.7.3
Vibration Resistance		
- Shock (operational)	Pass	4.7.4.1
- Impact (operational)	Pass	4.7.4.2
- Vibration, sinusoidal (operational)	Pass	4.7.4.3
- Vibration, sinusoidal (endurance)	Pass	4.7.4.4
Electrical stability		
- EMC, immunity (operational)	Pass	4.7.5



Manager: *Василева*
Dedal dipl. eng. Anna Vasileva

Issued:
Burgas, 27 September 2023


Ref. No. 04-00

ANNEX I TO CERTIFICATE OF CONSTANCY OF PERFORMANCE 1922-CPR-1156/ 27.09.2023, page 2/2

Optical Smoke Detector, model OD24-5

Performance list, acc. to EN 54-7:2018

Essential Characteristics	Performance	Clause
Operational reliability		
- Individual alarm indication	Pass	4.2.1
- Connection of ancillary devices	Pass	4.2.2
- Monitoring of detachable detectors	Pass	4.2.3
- Manufacturer's adjustments	Pass	4.2.4
- On site adjustment of response behaviour	N/A	4.2.5
- Protection against the ingress of foreign bodies	Pass	4.2.6
- Responce to slowly developing fires	Pass	4.2.7
- Software controlled detector (when provided)	Pass	4.2.8
Nominal activation conditions / Sensitivity		
- Repeatability	Pass	4.3.1
- Directional dependence	Pass	4.3.2
- Reproducibility	Pass	4.3.3
Responce delay (responce time)		
- Air movement	Pass	4.4.1
- Dazzling	Pass	4.4.2
Tolerance to supply voltage		
- Variation in supply parameters	Pass	4.5
Performance parameters under fire conditions:		
- Fire sensitivity	Pass	4.6
Durability of Nominal activation condition/ Sensitivity		
Temperature resistance		
- Cold (operational)	Pass	4.7.1.1
- Dry heat (operational)	Pass	4.7.1.2
Humidity resistance		
- Damp heat, steady - state (operational)	Pass	4.7.2.1
- Damp heat, steady - state (endurance)	Pass	4.7.2.2
Corrosion resistance		
- Sulphur dioxide (SO ₂) corrosion (endurance)	Pass	4.7.3
Vibration Resistance		
- Shock (operational)	Pass	4.7.4.1
- Impact (operational)	Pass	4.7.4.2
- Vibration, sinusoidal (operational)	Pass	4.7.4.3
- Vibration, sinusoidal (endurance)	Pass	4.7.4.4
Electrical stability		
- EMC, immunity (operational)	Pass	4.7.5

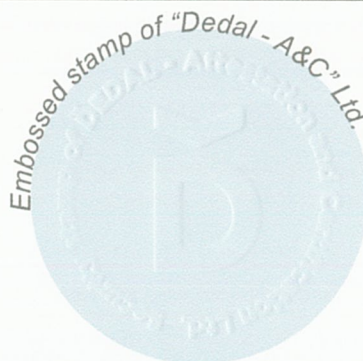

Manager:

Asuncova



dipl. eng. Anna Vasileva

Issued:
Burgas, 27 September 2023

Ref. No. 04-00