

CERTIFICATE

of constancy of performance

1922 - CPR - 2404

In compliance with Regulation (EU) 305/2011 of the European Parliament and of the Council of 9 March 2011 (the Construction Products Regulation or CPR), this certificate applies to the construction product

Fire detection and fire alarm systems. Smoke detectors - Point smoke detectors that operate using scattered light, transmitted light or ionization.

Model: ECP2L3 - Optical smoke detector with mounting base ECDB3.

(For list of controlled characteristics, see Annex I to 1922 - CPR - 2404 that is an inseparable part of this certificate)

placed on the market under the name or trade mark of

EDS Elektronik Destek San. ve Tic. Ltd. Şti

Meclis Mah. Teraziler Cad. Hayran Sok. No:4 Postal Code : 34785

Sancaktepe/ İstanbul/ Türkiye

and produced in the manufacturing plant of

EDS Elektronik Destek San. ve Tic. Ltd. Şti

Meclis Mah. Teraziler Cad. Hayran Sok. No:4 Postal Code : 34785

Sancaktepe/ İstanbul/ Türkiye

This certificate attests that all provisions concerning the assessment and verification of constancy of performance described in Annex ZA of the standard

EN 54-7:2018

under system 1 for the performance set out in this certificate are applied and that the factory production control conducted by the manufacturer is assessed to ensure the constancy of performance of the construction product.

This certificate was first issued on 27.06.2025 and will remain valid until 27.06.2026 as long as neither the harmonised standard, the construction product, the AVCP methods nor the manufacturing conditions in the plant are modified significantly, unless suspended or withdrawn by the notified product certification body. The certificate is supported through annual surveillance audit and is reissued after each surveillance audit. The validity of the certificate may be confirmed in the CE register at the web address www.dedal-bg.net.



Manager:

Anna Vasileva



dipl. eng. Anna Vasileva

Issued:
Burgas, 27 June 2025


Ref. No. 01-00

ANNEX I TO CERTIFICATE OF CONSTANCY OF PERFORMANCE 1922 - CPR - 2404/27.06.2025 (page 1 of 1)

Performance list, acc. to EN 54-7:2018

Model: ECP2L3 - Optical smoke detector with mounting base ECDB3.

Essential Characteristics	Performance	Clause
Operational reliability		
- Individual alarm indication	Pass	4.2.1
- Connection of ancillary devices	Pass	4.2.2
- Monitoring of detachable detectors	Pass	4.2.3
- Manufacturer's adjustments	Pass	4.2.4
- On site adjustment of response behaviour	Pass	4.2.5
- Protection against the ingress of foreign bodies	Pass	4.2.6
- Response to slowly developing fires	N/A	4.2.7
- Software controlled detector (when provided)	Pass	4.2.8
Nominal activation conditions / Sensitivity		
- Repeatability	Pass	4.3.1
- Directional dependence	Pass	4.3.2
- Reproducibility	Pass	4.3.3
Response delay (response time)		
- Air movement	Pass	4.4.1
- Dazzling	Pass	4.4.2
Tolerance to supply voltage		
- Variation in supply parameters	Pass	4.5
Performance parameters under fire conditions:		
- Fire sensitivity	Pass	4.6
Durability of Nominal activation condition/ Sensitivity		
Temperature resistance		
- Cold (operational)	Pass	4.7.1.1
- Dry heat (operational)	Pass	4.7.1.2
Humidity resistance		
- Damp heat, steady - state (operational)	Pass	4.7.2.1
- Damp heat, steady - state (endurance)	Pass	4.7.2.2
Corrosion resistance		
- Sulphur dioxide (SO2) corrosion (endurance)	Pass	4.7.3
Vibration Resistance		
- Shock (operational)	Pass	4.7.4.1
- Impact (operational)	Pass	4.7.4.2
- Vibration, sinusoidal (operational)	Pass	4.7.4.3
- Vibration, sinusoidal (endurance)	Pass	4.7.4.4
Electrical stability		
- EMC, immunity (operational)	Pass	4.7.5

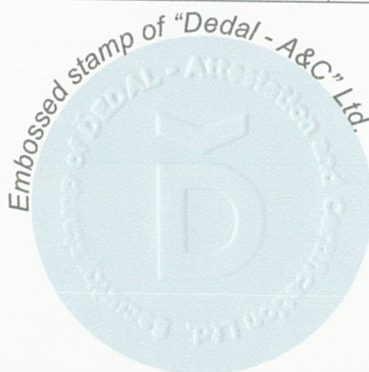

Attestation & Certification

Manager:

Baumba



dipl. eng. Anna Vasileva

Issued:
Burgas, 27 June 2025

Ref. No. 01-00